


Esquema técnico orientativo de la escalera mecánica INYMAN Andros

*PCC = por cuenta del cliente

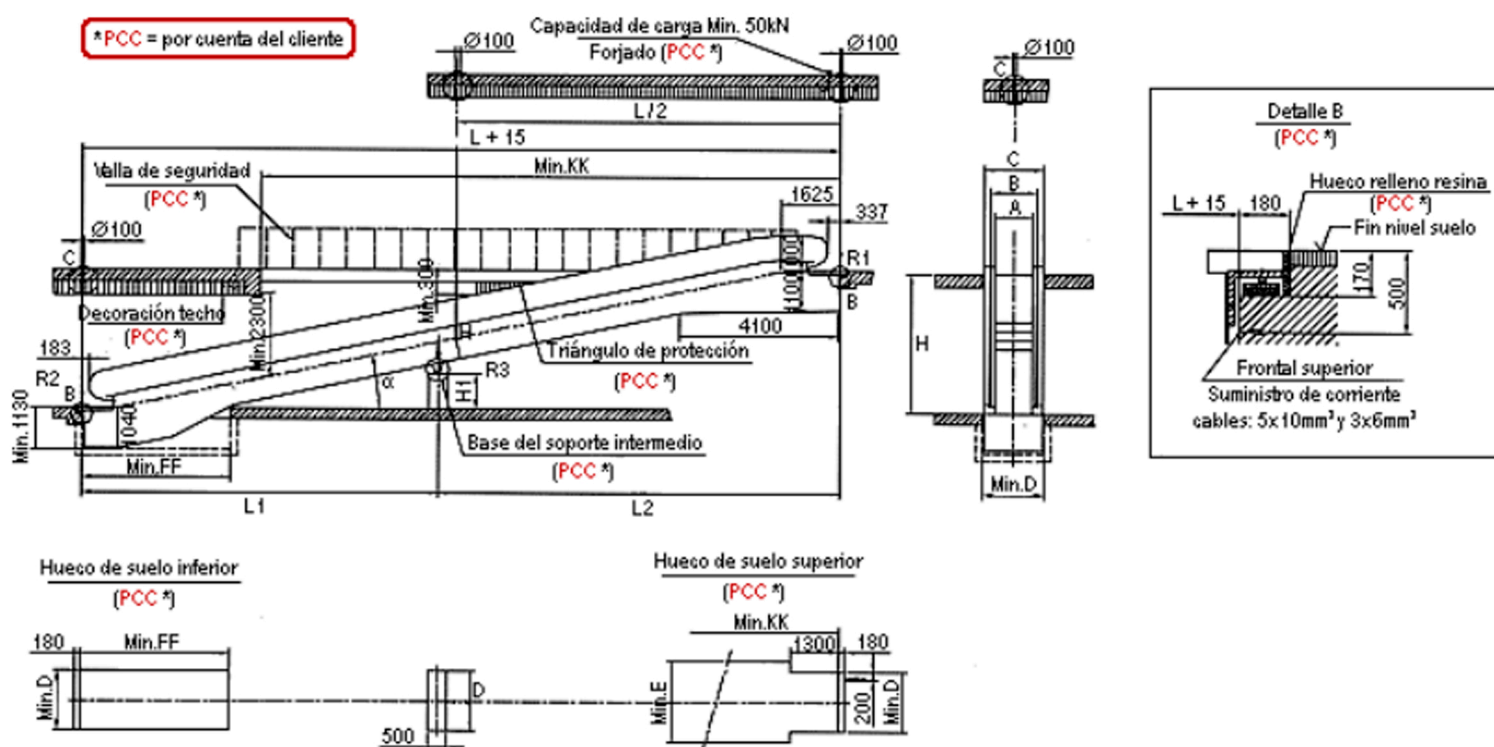

A	800	1000
B	1030	1230
C	1395	1595
D	1450	1650
E	2040	2240

A	R(KN)
800	$R1=3.5*L2+14.5$
	$R2=3.5*L1+7.2$
	$R3=4.1*L+16$
1000	$R1=3.9*L2+16$
	$R2=3.9*L1+7.9$
	$R3=4.5*L+17.5$

Nota: L, L1, L2 en metros. L1, L2 no más de 15m. Sólo disponible con un soporte intermedio.

α	L	H1	KK	FF
10°	$H*5.671+2660$	$0.1763*L1-1043$	18000	4500
11°	$H*5.145+2565$	$0.1944*L1-1067$	17000	4250
12°	$H*4.705+2485$	$0.2126*L1-1048$	16000	4000